

Since 1961

Electrical India

India's oldest magazine on power and electrical products industry



Annual 2015

Peeping Into The Indian Power Sector



DESMA

Silicone Injection Moulding



Strategies for Success...



www.desma.biz

A Chary Publication




Scan the QR Code to know more about EI Website

Follow us on

SUBSCRIBE/RENEW Online • Log on to www.electricalindia.in



Appraisal Of Centralised And Decentralised Energy Systems

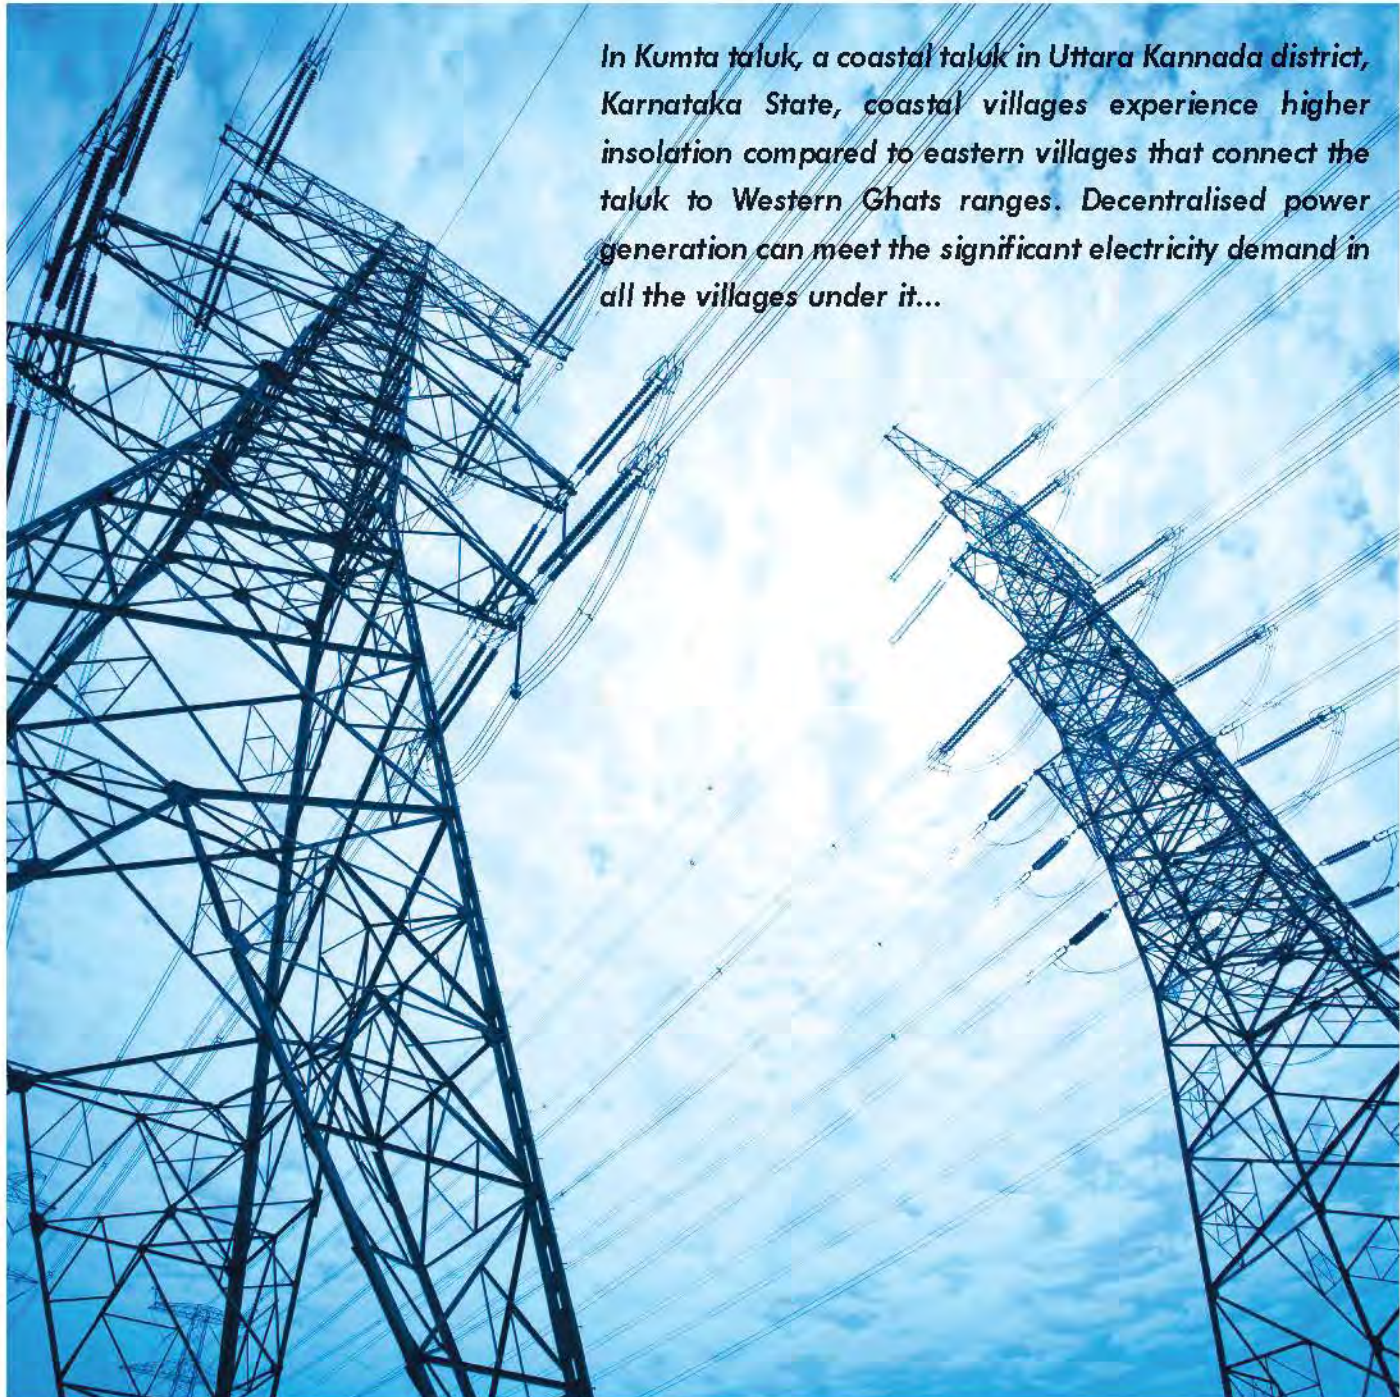

In Kumta taluk, a coastal taluk in Uttara Kannada district, Karnataka State, coastal villages experience higher insolation compared to eastern villages that connect the taluk to Western Ghats ranges. Decentralised power generation can meet the significant electricity demand in all the villages under it...

www.electricalindia.in



Grid system based on centralised electricity generation has posed serious challenges to the environment, as well as to the economy. These systems have failed to electrify every household in the country due to technical and economical non-feasibility apart from higher transmission and distribution losses. In this context, Distributed Generation (DG) has been playing a prominent role in the regional development, as well as electrification of remote villages. DG optimally harvests locally available renewable energy sources and integrates with the grid. Regional Integrated Energy Plan (RIEP) based on decentralised energy systems optimises share of available resources while ensuring reliable energy supply. Spatial assessment of renewable energy sources aids in effective planning to meet the energy demand at local levels. An optimal energy plan based on renewable energy sources mitigate GHG emissions, while providing reliable energy to all citizens in India.

Distributed Generation (DG) based on locally available renewable sources of energy would play pivotal role in meeting the energy demand throughout the country. Distributed generation refers to the electric energy generation near load centres using locally available resources. Installed capacity of decentralised plants ranges from few kilowatts to megawatts. DG include various renewable energy based generating technologies such as rooftop solar PV installation, micro/pico hydro power generation, small scale wind plants, biomass gasifier, combined heat and power (CHP) plants etc. These DG systems have very minimal environmental impact and are easier to install and operate. Since the generated energy will be supplied to the local community load, transmission and distribution losses will be greatly reduced. The other benefits of DG include improvement in power quality, avoiding or reduced transmission line extension costs due to generation at load centres, reduced power loss and reduction in energy price at local level while contributing to rural electrification. The centralised power systems have posed many technical challenges such as higher Transmission and Distribution (T&D) losses, frequent voltage variation, frequency variation and reliability concerns with massive environmental pollution. There are more than

24,000 villages that are not electrified even today, and many of them are in very remote places where the grid extension is economically non-feasible. The grid extension to remote location costs about INR 1 kWh/km, which is economically not viable with the present higher T&D losses. T&D losses have increased from 17.5% (in 1970-71) to 24.1% (in 2011-12) over 4 decades in spite of development in technology and use of efficient transmission conductors. Figure 1 shows the T&D losses in the country over the years. Increased T&D losses stress the transmission line and necessitate higher generation of electricity.

Grid expansions for rural electrification in remote areas are expensive and inefficient necessitating distribution generation system. Even already electrified villages are facing the problem of unreliable power supply coupled with frequent severe voltage fluctuations. However, DGs based on locally available renewable energy sources with the lower T&D losses have proved to be economically viable and technically feasible.

Fig. 2 illustrates (Kamalapur et al. 2010) the cost appreciation as the distance of the load centre and grid increases. Beyond 6 km, grid expansions are economically non-viable. This necessitates onsite generation (DG) and distribution to households in remote areas to minimise the investment on infrastructure apart from Transmission & Distribution (T&D) loss of electricity. Line loss reduction with DG integration has been computed for various levels of penetration. Estimates indicate annual loss to the tune of 264 billion units (26400 GWh) or which costs minimum of INR 55 billion

per year due to transmission and distribution inefficiency (Table 1). Current assessment reveals that T&D loss in India is about 24% resulting in the loss of 220 kWh/capita (per capita consumption is 917.18 kWh) of energy. Cost per capita of energy loss ranges from INR. 462 (@ INR. 2.10/kWh) to INR. 3220 (@ INR. 7/kWh) depending upon the tariff (in the respective state).

This necessitates deployment of DG using locally available resources to improve the efficiency of electricity transmission and distribution. India is targeting 22000 MW of solar installed capacity by 2022, in which distributed generation holds the promise. India is one of the frontiers of wind generation with installed capacity of over 21 GW after China, US, Germany and Spain. Taluk level energy assessment gives insights to explore the feasibility of distributed generation opportunities and connect un-electrified villages in the region. This also helps in integrating renewable energy resources to the existing grid, which will improve the power quality.

Study Area: Kumta, a coastal taluk in Uttara Kannada district, Kamataka State, is located between the Arabian Sea coast on the west and Sahyadri ranges (Western Ghats) on the eastern side (14.42°N & 74.4°E). Taluk spreads over 590.45 km² of area with population of 1,54,515 (Census 2011). Taluk is blessed with lush green forests, which cover more than 65% of the geographical area and about 16% of the area is under agriculture/horticulture or plantation. Fig. 3 shows the study area with annual average solar insolation and wind speed.



Fig. 1: T & D losses in the country from 1970-11 to 2011-12



Decentralised Generation >>

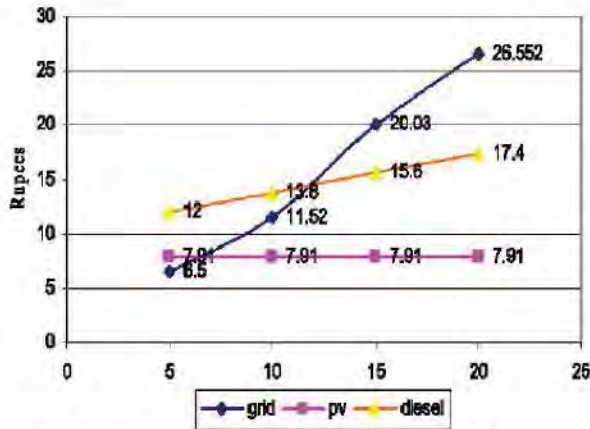


Fig. 2: Comparison of PV, diesel generator and grid electricity for rural electrification...

Spatio-temporal data are used for energy potential assessment using open source GIS platform, which also gives the seasonal and geographical variability of the available energy resources. Long term data sets acquired from NASA SSE (Solar GHI) and Climate Research Unit (CRU) (Wind Speed) are reliable and depicts the seasonal variability, which is closely correlated with ground measurement. Taluk experiences abundant solar insolation of more than 5.5 kWh/m²/d throughout the year in all the villages. Coastal villages experience higher insolation compared to eastern villages that connect the taluk to Western Ghats ranges. However, decentralised generation can meet the significant electricity demand in all the villages. Fig. 4 shows the seasonal variability of the solar energy potential across the villages. During summer (February to May) Kumta experience solar insolation of more than 5.6 kWh/m²/d, which reduces to less than 5 kWh/m²/d during Monsoon (June to August). The radiation reception also varies in these months, which will affect the electricity generation. During winter (October to January), the taluk receives insolation ranges from 5 to 5.5 kWh/m²/d.

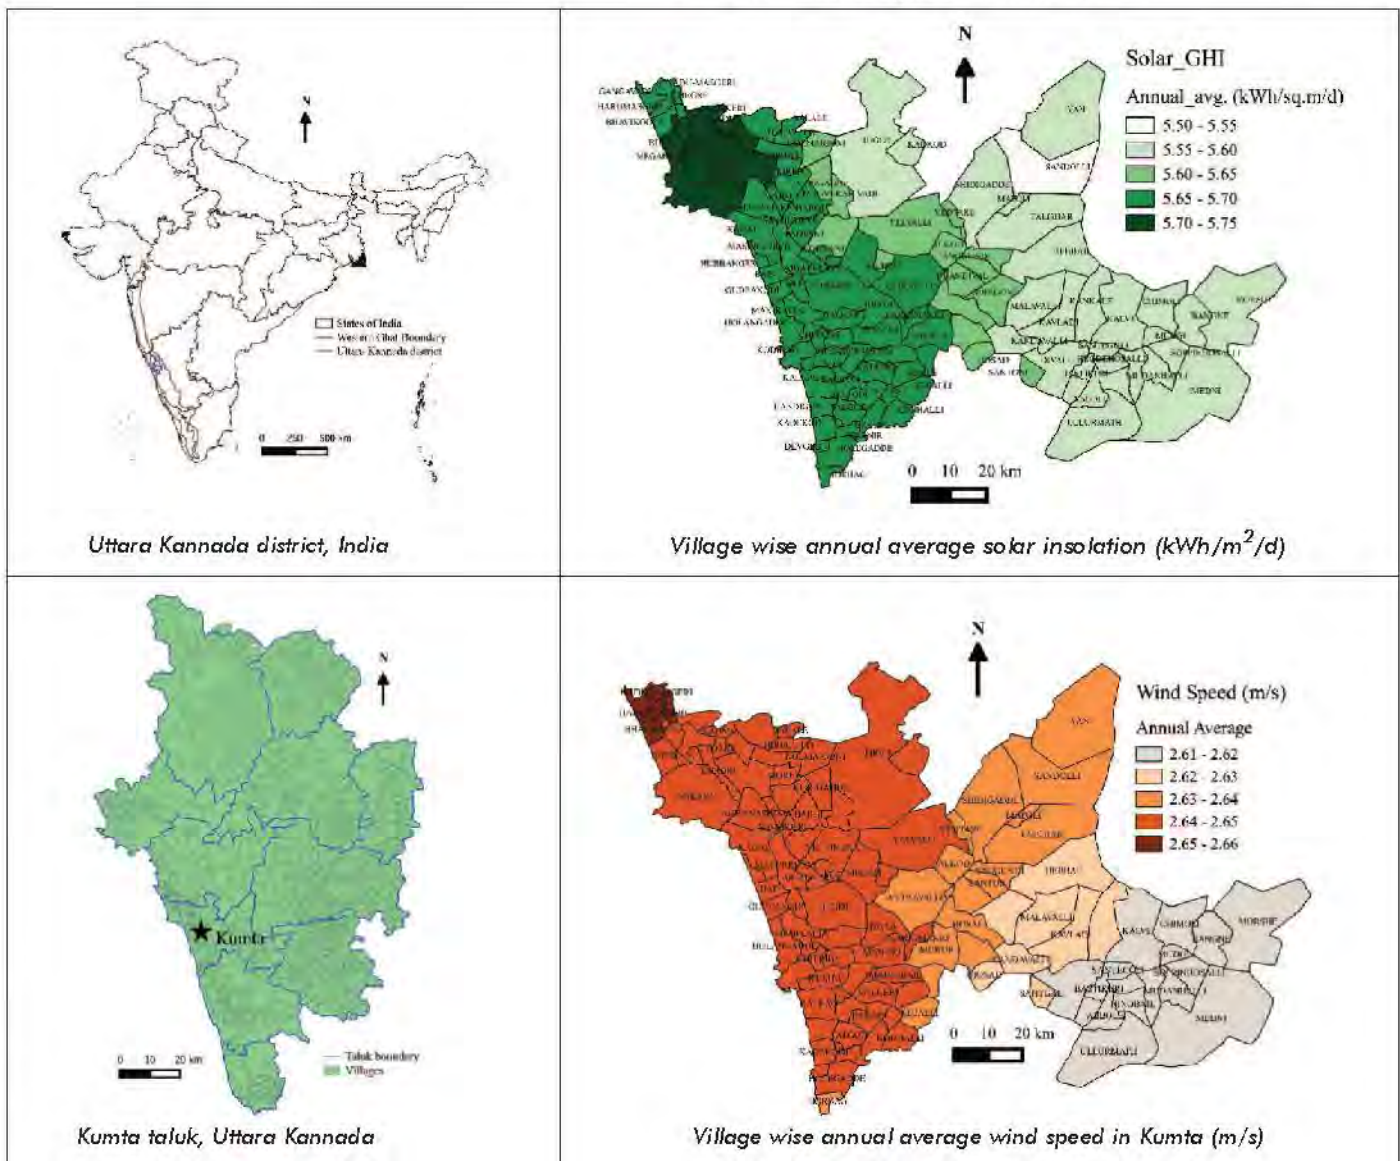


Fig. 3: Study area – Kumtataluk, Uttara Kannada, Karnataka, India...



Per capita electricity consumption	917 kWh
T&D losses	24%
Per capita energy loss	220 kWh
Cost of per capita energy loss	INR 462 to INR 3220
Annual energy loss	264GWh
Total annual expenditure	INR 55,440 crores (@ INR. 2.10/kWh)
Table 1: Expenditure due to T&D losses in India...	

Fig. 5 gives the wind speed variability in the taluk across the months. The coastal villages experience higher wind speed of more than 2.65 m/s annually compared to the eastern villages (2.61 m/s). Though the variation in annual average wind speed is minimum, seasonal variation is higher due to the swift winds during monsoon. During summer and winter, the taluk experiences lower wind speed which ranges from 2 to 3 m/s. During monsoon, it experiences speedy winds that varies from 3 to 4 m/s. Solar & wind resources supplement each other, which supports hybrid energy systems in the region.

Table 2 lists Land Use and Land Cover (LULC) details of Kumta taluk, blessed with bioenergy resources as most of the people practice agriculture/horticulture, which is the primary income of livelihood. About 16% of the total geographical area is under agriculture/horticulture or contains coconut and areca plantations that generate large amount of high energy residues – such as coconut shell, rice stalk etc., which can be used in bio-gasifiers. The taluk has 21.4% of evergreen forest, 12.5% semi-evergreen/moist deciduous forest, 7.3% of dry deciduous forest and 3.4% of acacia plantations which ensure the availability of plant residues with higher energy content throughout the year. These plant residues are being used for domestic purposes and sufficient quantity is available to use as a fuel for bio-gasifiers towards electricity generation.

Regional Integrated Energy Plan

Integrated energy plan essentially explores the locally available energy resources and feasible energy conversion technologies

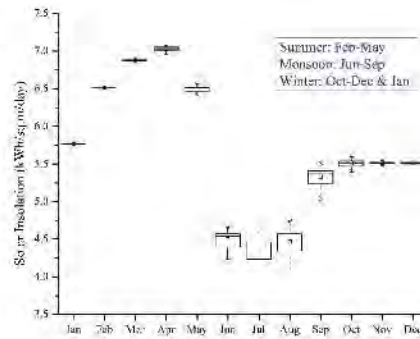


Fig. 4: Solar insolation variability...

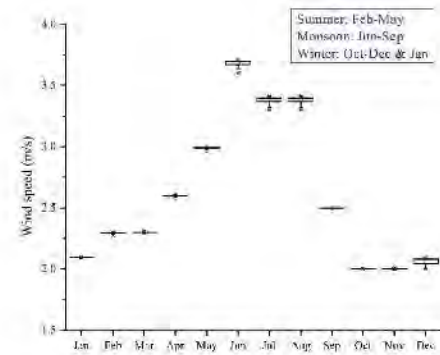


Fig. 5: Wind speed variability...

to meet the regional demand. The energy planning exercise carried out for Kumta taluk involves minimisation of annual cost function to a set of equality and inequality constraints using Linear Programming (LP) algorithm. The main objective of the energy planning is preparation of location specific decentralised energy harvesting systems for meeting the regional energy needs. This ensures least cost to the environment and the economy. Centralised energy generation and transmission cannot pay much attention to the variations in socio-economic and ecological factors of a region, which influence success of any intervention. Decentralised energy planning focuses on efficient utilisation of resources, while ensuring more equitable sharing of benefits from development. The integrated energy planning mechanism takes into account all resources available and end use demand of a region. This implies that the assessment of the demand and supply, and the intervention in the energy system, which may appear desirable due to such exercises, must be at a similar geographic scale. Resource assessment done using remote sensing data with Geographic Information System (GIS) and field data compilation. Regional integrated energy model based on DG minimises the operating cost while ensuring reliable sufficient energy supply and ensures the total energy supply. The process is a constrained optimisation problem where, maximum available energy from each resource and minimum energy requirement for every end use are considered as constraints. Fig. 6 illustrates the procedure adopted in the study.

The present study deals with the village wise potential assessment of renewable energy resources in Kumta taluk of Uttara Kannada district, Karnataka state. The district lies in the central Western Ghats (WG), which is one among 35 biodiversity hotspots in the world. District is a repository of diverse endemic flora and fauna and also receives higher solar insolation for about 300 days in a year. The coastal villages of Kumta, experiences greater wind speeds, which are high wind energy potential areas. The taluk also receives higher insolation that encourages the solar power plant installation. Spatio temporal (across villages and seasons) variability of resources have been analysed to optimise the energy harvesting with best locations as well as efficient end-use energy devices. Harvesting solar and wind energy ensures the availability throughout the year as wind complements the lower solar insolation period during monsoon. Further, number of end uses and available resources are identified. Resource-task matching is modelled where the Linear Programming (LP) is used for optimisation. Cost minimisation is also explored while meeting the total energy demand with available local resources.

System is designed to use only locally available renewable energy sources, which however have lower pollution. End use energy requirement per capita is assessed and total energy requirement per end use is computed and validated with field data. Table 3 gives the energy requirement for different end uses in the taluk.

Low temperature heating (<100°C) end uses such as water heating for bathing, agro-

Category	Area (Ha)
Built up	1727.6
Cropland/Agriculture	5149.2
Openspace	5984.0
Coconut/Areca	4428.9
Semi-evergreen/Moist-deciduous	7370.5
Evergreen	12638.4
Scrub/Grass	15190.2
Acacia	2018.8
Dry-deciduous	4351.5
Total	58859.63

Table 2: Land use land cover (LULC) details of Kumtatuluk...

processing (drying of local agro products such as areca nut, coconut, cashew, pepper etc.) etc. has the highest share (485 GWh/annum) in the total energy required followed by medium temperature heating (411.7 GWh/annum) and medium power mechanical end uses (43.4 GWh/annum). The agro processing activity, which includes drying of areca nut, coconut, cashew nut, cardamom and other spices requires lot of low temperature heat energy (80-100°C) throughout the year. Direct electricity consumption is only for lighting, fans and television in homes, commercial spaces and road lights, which consume about 37.2 GWh/annum. Table 4 shows the efficiency of the energy conversion processes to meet the end use energy requirements.

The efficiencies of various energy conversion technologies are estimated from literatures and few are computed. However, these values do not overestimate the output energy obtained by energy conversion. Table 5 gives the load factor assumed in the present energy planning process. Maximum energy availability from each resource in the taluk has been computed by converting available quantity into its corresponding energy equivalent. Abundant solar energy is available (both solar thermal and electric energy) in the taluk where the harvestable energy is about 2,860 GWh/annum. Similarly, about 670 GWh/annum of energy can be extracted from biomass and agro-horti residues in the region.

Annual energy availability from all the resources in the village is given in Table 6.

The wind energy harvesting depends on the swept area of the wind blades. The taluk has more than 31 km of coast line on the west, which can generate ample energy from wind resource. Depending upon end use energy requirement, micro (few watts) to small scale (few kilo watts) wind generator can be installed in the coastal villages for irrigation and electricity generation. Wind plants can also be integrated with solar or bioenergy plants, which can address the intermittency issues. Energy available from biogas and electricity is limited to 0.1 GWh / annum and 0.43 GWh / annum respectively. The optimised operating costs for meeting the end use from available resources is shown in Table 7.

Total operating cost of the model is found to be INR 22.11 crores per annum with unit cost of INR 0.22 per kWh of energy utilised. Cost of generating mechanical energy from wind resources is found highest (INR 7.3 crores) followed by solar thermal energy generation (INR 4.9 crores) and generating electricity from biogas (INR 2.46 crores). However, electric energy application for medium power mechanical end use has the lowest operating cost (INR 8945.3) where the electricity is directly obtained from grid. Total energy supplied for various end uses is about

983.5 GWh/annum from all resources. Table 8 gives the energy supply patterns from resources to different end uses.

Energy harvested from solar resource is about 250.9 GWh/annum which is used to meet the low temperature heating requirement. Wind energy resource is used for low (6.2 GWh/annum) and medium power mechanical (12.8 GWh/annum) end uses contributing about 19.09 GWh/annum. Ample biomass resource is available in the taluk, which is utilised for low (234.05GWh/annum) and medium temperature heating (411.7 GWh/annum) and also to generate electricity (24.2 GWh/annum). Similarly, biogas is used for electricity generation (12.94 GWh/annum)

End use type	Energy required (GWh/annum)
Low temperature heating	485.0
Medium temperature heating	411.7
Low power mechanical	6.2
Medium power mechanical	43.4
Lighting, fan etc.	37.2
Total	983.5

Table 3: Energy requirement for different end uses

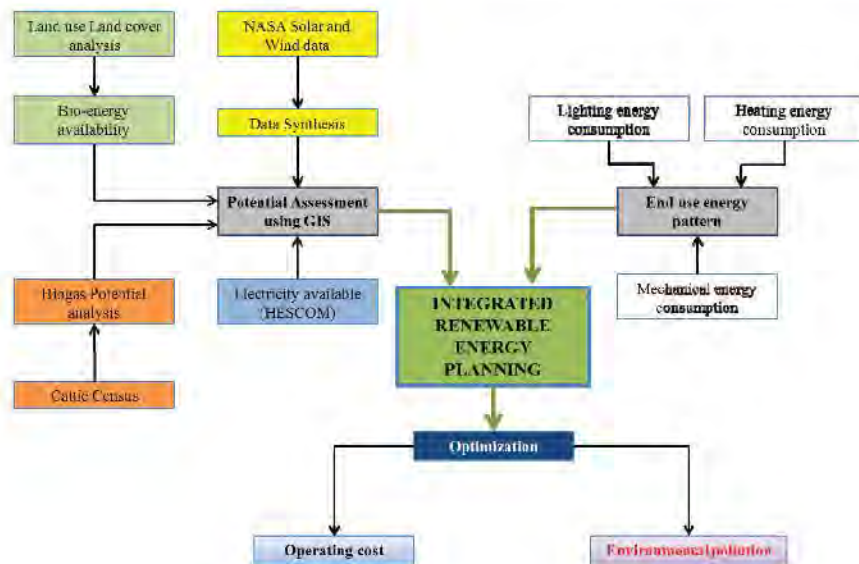


Fig. 6: Integrated energy plan at regional levels...



and grid electricity supply is utilised to meet the medium power mechanical end use energy requirement (30.53 GWh/annum). Model is successfully simulated the resources and end use combination to generate feasible solution with minimum operating cost. However, it can also be inferred that, taluk can meet all the energy needs from locally available resources while maintaining efficiency and minimum cost. Since the energy system utilises renewable energy sources, significant greenhouse gas emission can be avoided, which is an essential step to reduce global warming. This model will

generate employment in the village level which contributes to the development of the region and energy security.

Discussion and Conclusion

Focus on the renewable energy potential with integrated energy plan highlight the availability of sufficient resources to meet the demand at the taluk level. Kumta taluk receives abundant solar insolation throughout the year, which varies from 5.5 to 5.75 kWh/m²/day. Annual average insolation of the district is about 5.5 kWh/m²/day where, it experiences more than 5.6 kWh/m²/day for

about 250 days. District experiences wind from west coast, which varies from 1.9 to 4 m/s where coastal villages have higher wind energy potential. Low speed wind turbines are most suitable for the region, which can be used for irrigation and electricity generation. Wind energy generation systems can also be integrated with solar and biomass gasifier based generator for reliable electricity production. Village level energy potential maps give insights for distributed generation from rooftop level to installation in barren lands. Seasonal variation in the resource availability will help in understanding the dynamics and pattern of energy generation, which is a critical information for grid integration and load expansion.

Quantification of bioenergy is carried out based on availability, which shows that about 670 GWh energy is available annually. Similarly, the taluk has good number of cattle and buffalo population, which can generate about 12.9 GWh of energy annually. Energy from plant and animal residues can be utilised for low and medium temperature heating and also for electricity production.

Integrated energy plan with the objective of cost minimisation is developed and validated. Optimisation results shows that, annual operating cost of the system is INR 22.11 crores and unit energy cost is about INR 0.22/kWh. The simulated model could supply 983.5 GWh/annum to meet the various end use energy requirements. System installation and commissioning could be decentralised and resources shall be harvested depending upon the availability. Nevertheless, the work illustrates the

η_{ij}	Low temp heating	Med. temp heating	Low power mech.	Med. Power mech.	Lighting, fan etc.
Solar	0.4	0.3	-	-	0.1
Wind	-	-	0.4	0.4	0.3
Biomass	0.15	0.15	-	-	0.3
Biogas	0.65	0.6	-	-	0.35
Electricity	-	-	0.8	0.75	0.8

Table 4: Energy conversion efficiency...

k_{ij}	Low temp heating	Med. temp heating	Low power mech.	Med. power mech.	Lighting, fan, etc.
Solar	0.29	0.35	-	-	0.35
Wind	-	-	0.3	0.2	0.35
Biomass	0.29	0.35	-	-	0.35
Biogas	0.29	0.35	-	-	0.35
Electricity	-	-	0.65	0.65	0.65

Table 5: Load factor...

Resource	Energy potential (GWh/annum)
Solar	2860.6
Wind	39.44 kWh/m ² of swept area
Biomass	670
Biogas	12.9
Electricity	30.5
Total	3574.17

Table 6: Available maximum energy potential...

Cost (INR/annum)	Low temp. heating	Med. temp. heating	Low power mech.	Med. power mech.	Lighting, fan, etc.
Solar	49494102.3	0	0	0	0
Wind	0	0	19711392.7	73755336.96	0
Biomass	153862.2	448498.1	0	0	52893514.4
Biogas	0	0	0	0	24679188.6
Electricity	0	0	0	8945.3	0
Total Cost (INR)	22.11 crores				
Unit cost (INR/kWh)	0.22				

Table 7: Optimised cost matrix of the energy model...

www.electricalindia.in



Energy (GWh/ annum)	Low temp. heating	Med. temp. heating	Low power mech.	Med. power mech.	Lighting, fan, etc.	Energy utilised
Solar	250.9	0	0	0	0	250.9
Wind	0	0	6.2	12.8	0	19.09
Biomass	234.05	411.7	0	0	24.2	670
Biogas	0	0	0	0	12.94	12.94
Electricity	0	0	0	30.53	0	30.53
End use energy supplied	485	411.7	6.2	43.4	37.2	983.5

Table 8: End use energy supplied from various resources...

availability of 983.5 GWh energy from locally available resources. Model implementation could significantly reduce the GHG emission while reducing the stress on central grid. It would also generate employment in the village level, which could also enable entrepreneurship opportunities. This model (Regional Integrated energy Plan: RIEP) is replicable in all taluks or cluster of villages, which highlights the flexibility and strength of

the approach. Integrated renewable energy planning has the potential to minimise the operating cost while exploiting sustainable, reliable and environment-friendly renewable energy sources. This transforms rural India to self-reliant and self-sustained systems with energy sufficiency, which helps in realising the dream of total electrification in the country and scope for employment and education opportunities at local levels.



Ganesh Hegde
 Research Scholar
 Energy and Wetlands Research Group
 Centre for Ecological Sciences, IISc



T V Ramachandra
 Faculty at Centre for Ecological Sciences (CES); Asso. Faculty at CST/ ASTRA and CISTUP, IISc

INNOVATIVE. ACCURATE. RELIABLE.

ORIGINAL DESIGN TECHNOLOGY. GLOBALLY ACCREDITED.



Automatic Instrument Transformer Test Set - AITS PLUS

- ARM 9 Processor Technology.
- Colour display of 800 x 480 TFT.
- Storage upto 1,00,000 results.
- Accuracy of better than 0.5% of reading.
- Pen drive for data storage.
- PC Interface software compatibility of Window 7 and above.
- Auto store and Auto print available.
- Alpha numerical metal dome membrane keypad available.
- Meets the latest IEC & ANSI Standards.
- Facility to connect external LCD display.
- RS-232 and USB Interfaces.



Eitel Industries, an ISO-9001-2008 certified organization established in 1983, is a market leader in the development and manufacturing of test instruments for electrical power industries and utilities. We are pleased to announce the NABL - accreditation of Eitel Industries - Calibration Laboratory in Electro-technical discipline including on-site calibration in accordance to ISO/IEC:17025/2005. We look forward to partnering with you.



ELTEL INDUSTRIES
 www.eitelindustries.com

311 Embassy Centre, Crescent Road, Bengaluru 560 001, India

TEL: +91-80-22256467, 22205686, 22284253, 22284298
 FAX: +91-80-22252733 EMAIL: marketing@eitelindustries.com